


Sendai Nuclear Power Station Unit 1: Plant status (Weekly notification)

Operations	
This week results (Fri, July 10 – Thu, July 16)	<p>[Main process]</p> <ul style="list-style-type: none"> ➤ The primary system (reactor system) <ul style="list-style-type: none"> • July 10 Fuel loading completed • July 13 Reactor vessel assembling started ➤ The secondary system (turbine system) <ul style="list-style-type: none"> • July 15 Cleanup started <p>[Tests and inspections]</p> <ul style="list-style-type: none"> ➤ Operator's self-inspection (periodical equipment inspection items) <ul style="list-style-type: none"> • July 10 Fuel assembly in-core configuration inspection • July 13-14 Safety protection system functional test • July 15 Auxiliary feedwater system functional test ➤ Regulatory inspection <ul style="list-style-type: none"> • July 12 Regulatory inspection related to mid-loop operation* started *In the mid-loop operation, core cooling continues with the reduced flow of coolant of which level is about the middle of the pipes • July 14 Fuel loading Regulatory inspection ended (started on July 6)
Next week plans (Fri, July 17 – Thu, July 23)	<p>[Main process]</p> <ul style="list-style-type: none"> ➤ The primary system (reactor system) <ul style="list-style-type: none"> • Reactor vessel assembling continues • Reactor coolant system (RCS) leak test preparation will start ➤ The secondary system (turbine system) <ul style="list-style-type: none"> • Cleanup continues • Condenser vacuum-up will start <p>[Tests and inspections]</p> <ul style="list-style-type: none"> ➤ Pre-service inspection <ul style="list-style-type: none"> • July 23 Item-4 inspection (Instrumentation control system) ➤ Operator's self-inspection (periodical equipment inspection items) <ul style="list-style-type: none"> • July 19 Containment vessel isolation valve functional test ➤ Regulatory inspection <ul style="list-style-type: none"> • Regulatory inspection related to mid-loop operation continues • July 23 Regulatory inspection starts in relation to training of workers to act in case of severe accidents and large-scale destructions

(translated by JANSI)

Sendai 1: Restart operation process

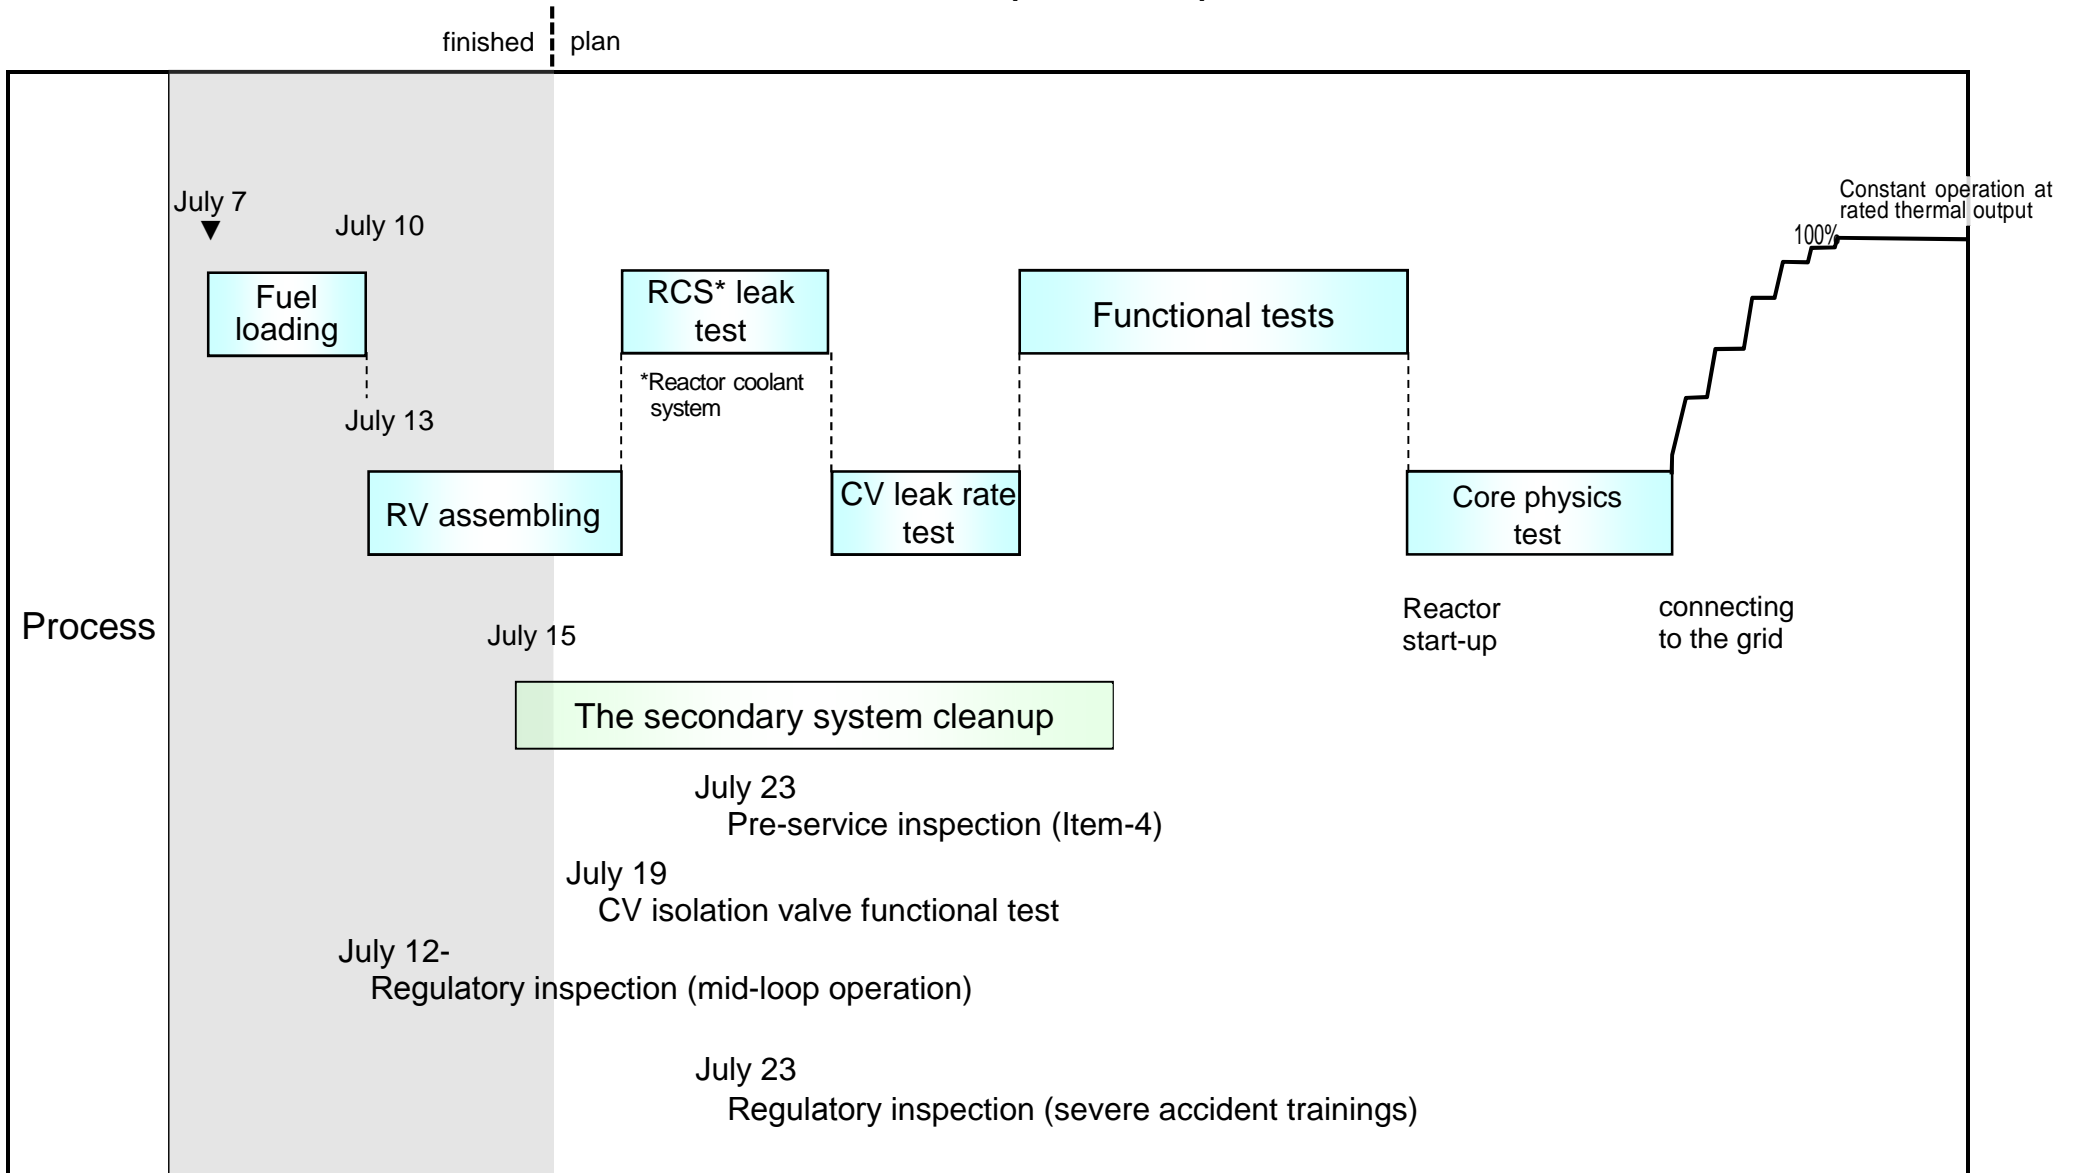

(translated by JANSI)

This is translation of articles in the press release by Kyushu Electric Power Company.

For the original text, please go to: http://www.kyuden.co.jp/library/pdf/torikumi_nuclear/news150717.pdf