

Sendai Nuclear Power Station Unit 1: Plant Status


(Daily Report: FINAL)

As of 11:30am Aug 31

| | Operations |
|---|---|
| Results (10:00, Aug. 30 – 11:30, Aug. 31) | <p>[Power output] Constant operation at rated thermal power is ongoing as of 11:30am, Aug. 31</p> <p>[Main process]</p> <ul style="list-style-type: none">➤ The primary system (reactor system)<ul style="list-style-type: none">• None➤ The secondary system (turbine and generator system)<ul style="list-style-type: none">• Aug 31 Load up beyond 100% was achieved• " Constant operation at rated thermal power was achieved <p>[Tests and inspections]</p> <ul style="list-style-type: none">➤ Operator's self-inspection (periodical equipment inspection items)<ul style="list-style-type: none">• None➤ Regulatory inspection<ul style="list-style-type: none">• Reactor start-up inspections are ongoing (started on Aug. 3) |

Aug. 31, 2015

Sendai Unit 1: Restart operation process

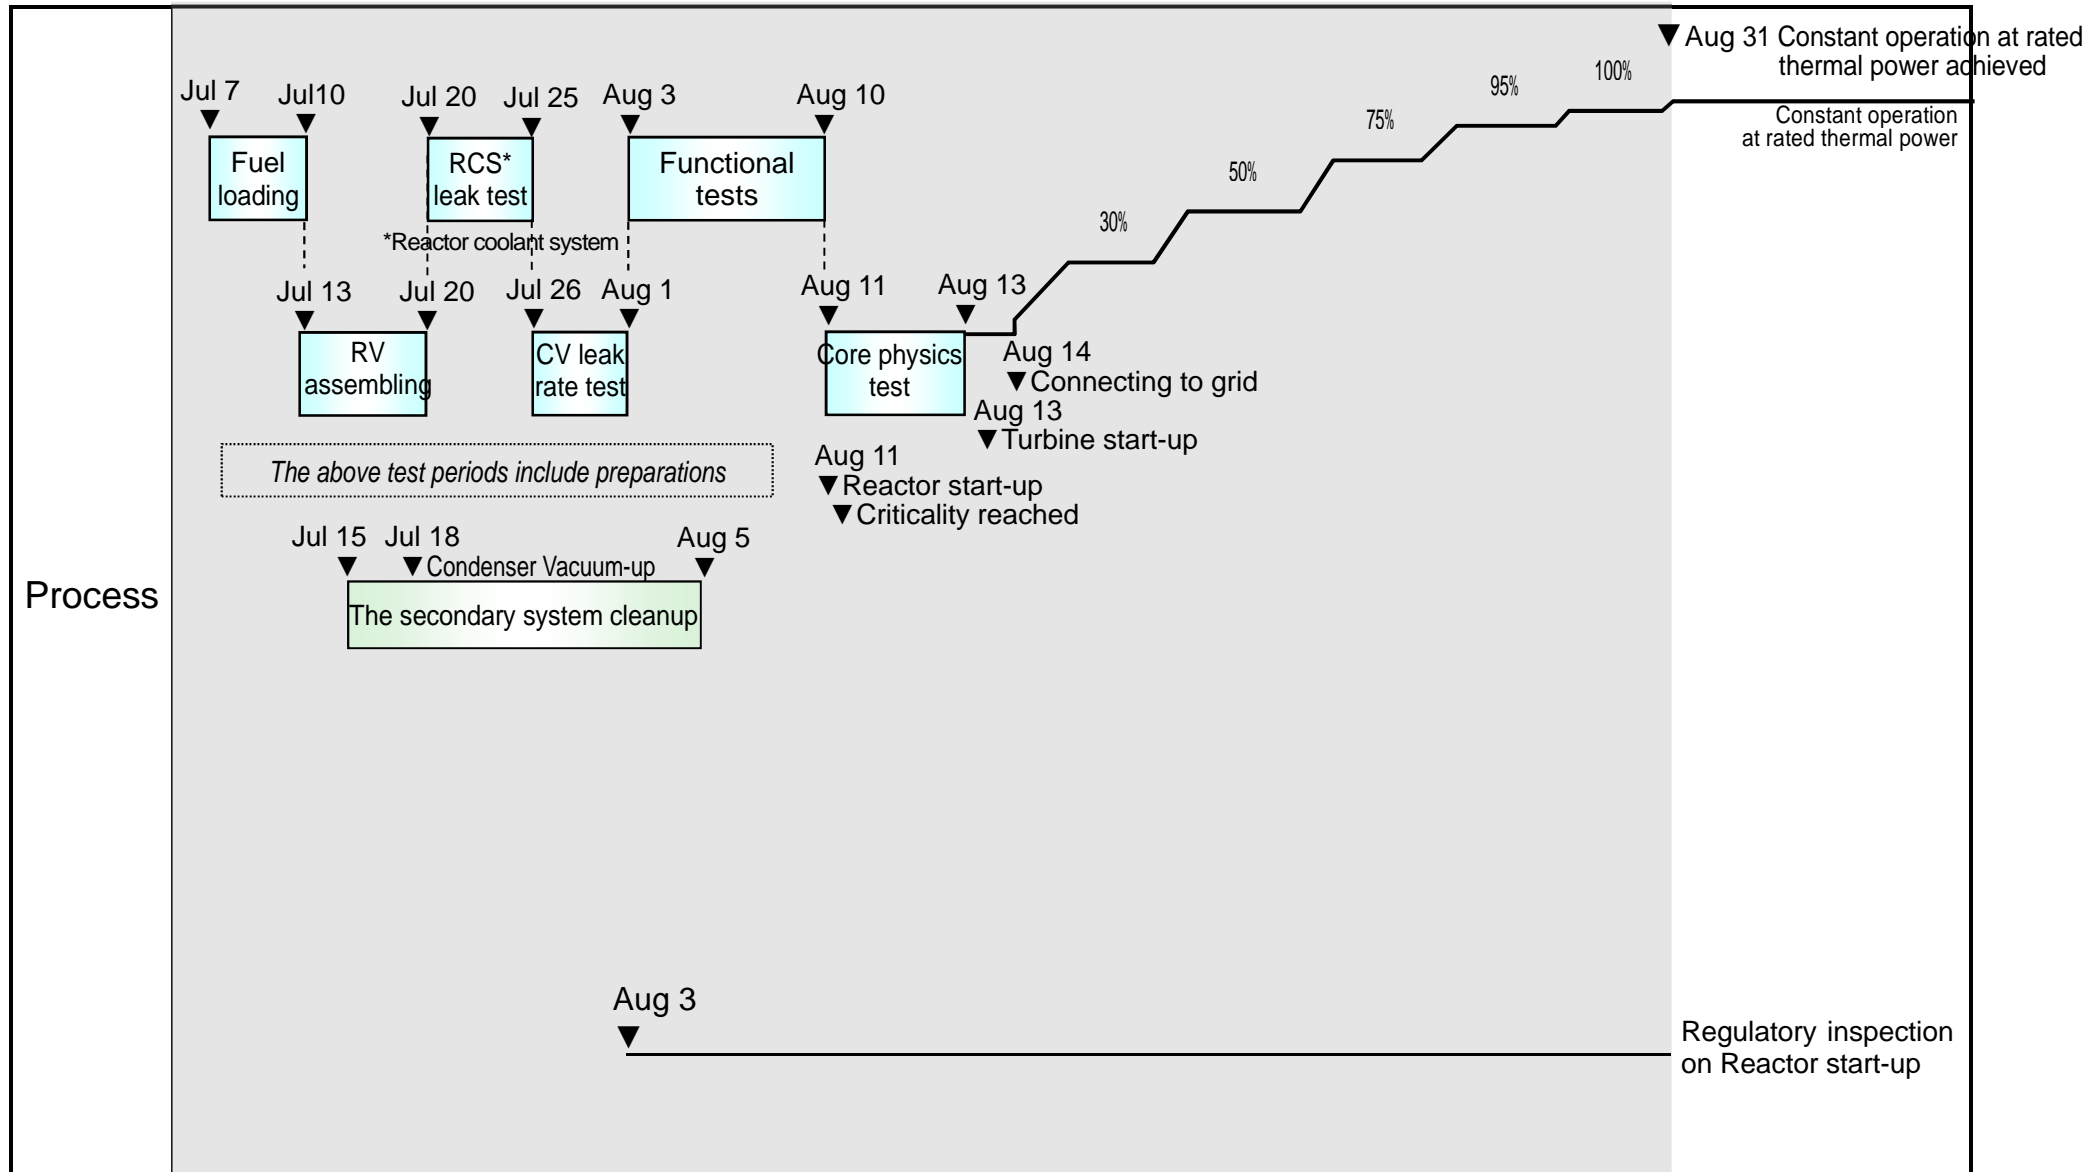

Translated by JANSI: for the original text, please go to: <http://www.kyuden.co.jp/var/rev0/0048/1073/news150831.pdf>