


Sendai Nuclear Power Station Unit 2: Plant status as of 10.00am, October 30 (Daily report)

Operations	
Results (10:00, Oct 29 – 10:00, Oct 30)	<p>[Electric power] Load up from 95% to 100% is in progress as of 10.00am, Oct 30</p> <p>[Main process]</p> <ul style="list-style-type: none"> ➤ The primary system (reactor system) <ul style="list-style-type: none"> • None ➤ The secondary system (turbine and generator system) <ul style="list-style-type: none"> • Oct 30 Load up from 95% to 100% as electric output started <p>[Tests and inspections]</p> <ul style="list-style-type: none"> ➤ Operator's self-inspection (periodical equipment inspection items) <ul style="list-style-type: none"> • None ➤ Regulatory inspection <ul style="list-style-type: none"> • Inspection associated with the reactor startup ongoing (started on Oct 8)
Plans (10:00, Oct 30 – Oct 31)	<p>[Main process]</p> <ul style="list-style-type: none"> ➤ The primary system (reactor system) <ul style="list-style-type: none"> • None ➤ The secondary system (turbine and generator system) <ul style="list-style-type: none"> • Oct 30 100% electric power will be achieved <p>[Tests and inspections]</p> <ul style="list-style-type: none"> ➤ Operator's self-inspection (periodical equipment inspection items) <ul style="list-style-type: none"> • None ➤ Regulatory inspection <ul style="list-style-type: none"> • Inspection associated with the reactor startup

Sendai Unit 2: Restart operation process

Oct 30, 2015

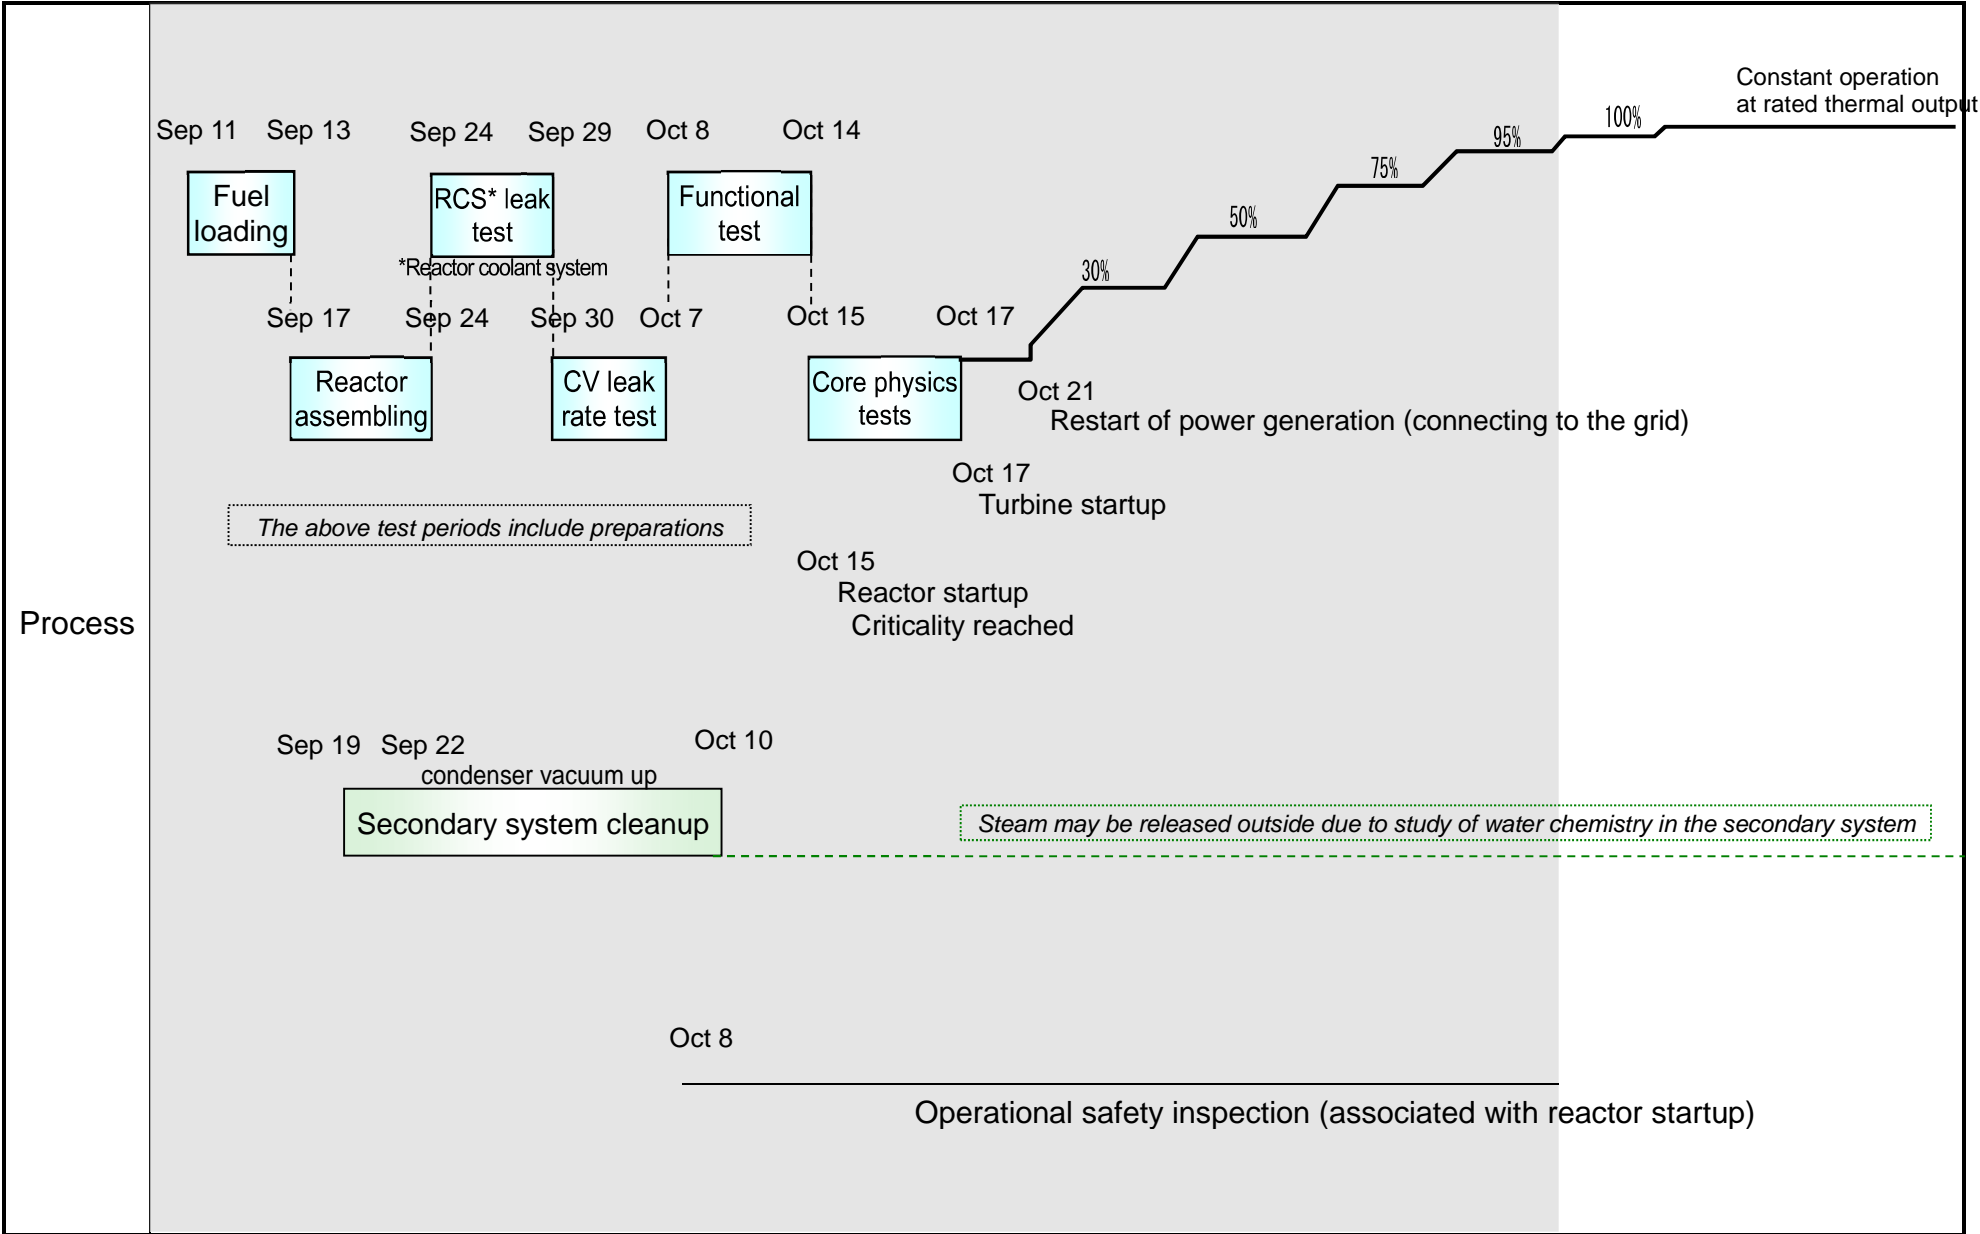

Translated by JANSI: For the original text, please go to: http://www.kyuden.co.jp/var/rev0/0049/0740/news_2_151030.pdf