


## Sendai Nuclear Power Station Unit 2: Plant status as of 10.00am, October 31 (Daily report)

Operations	
Results (10:00, Oct 30 – 10:00, Oct 31)	<p>[Electric power] <b>100% output is maintained</b> as of 10.00am, Oct 31</p> <p>[Main process]</p> <ul style="list-style-type: none"> <li>➤ The primary system (reactor system) <ul style="list-style-type: none"> <li>• None</li> </ul> </li> <li>➤ The secondary system (turbine and generator system) <ul style="list-style-type: none"> <li>• Oct 30 100% as electric output achieved</li> </ul> </li> </ul> <p>[Tests and inspections]</p> <ul style="list-style-type: none"> <li>➤ Operator's self-inspection (periodical equipment inspection items) <ul style="list-style-type: none"> <li>• None</li> </ul> </li> <li>➤ Regulatory inspection <ul style="list-style-type: none"> <li>• Inspection associated with the reactor startup ongoing (started on Oct 8)</li> </ul> </li> </ul>
Plans (10:00, Oct 31 – Nov 1)	<p>[Main process]</p> <ul style="list-style-type: none"> <li>➤ The primary system (reactor system) <ul style="list-style-type: none"> <li>• None</li> </ul> </li> <li>➤ The secondary system (turbine and generator system) <ul style="list-style-type: none"> <li>• Nov 1 Load up beyond 100% electric power will be conducted to reach constant operation with the rated thermal power</li> </ul> </li> </ul> <p>[Tests and inspections]</p> <ul style="list-style-type: none"> <li>➤ Operator's self-inspection (periodical equipment inspection items) <ul style="list-style-type: none"> <li>• None</li> </ul> </li> <li>➤ Regulatory inspection <ul style="list-style-type: none"> <li>• Inspection associated with the reactor startup</li> </ul> </li> </ul>

# Sendai Unit 2: Restart operation process

Oct 31, 2015

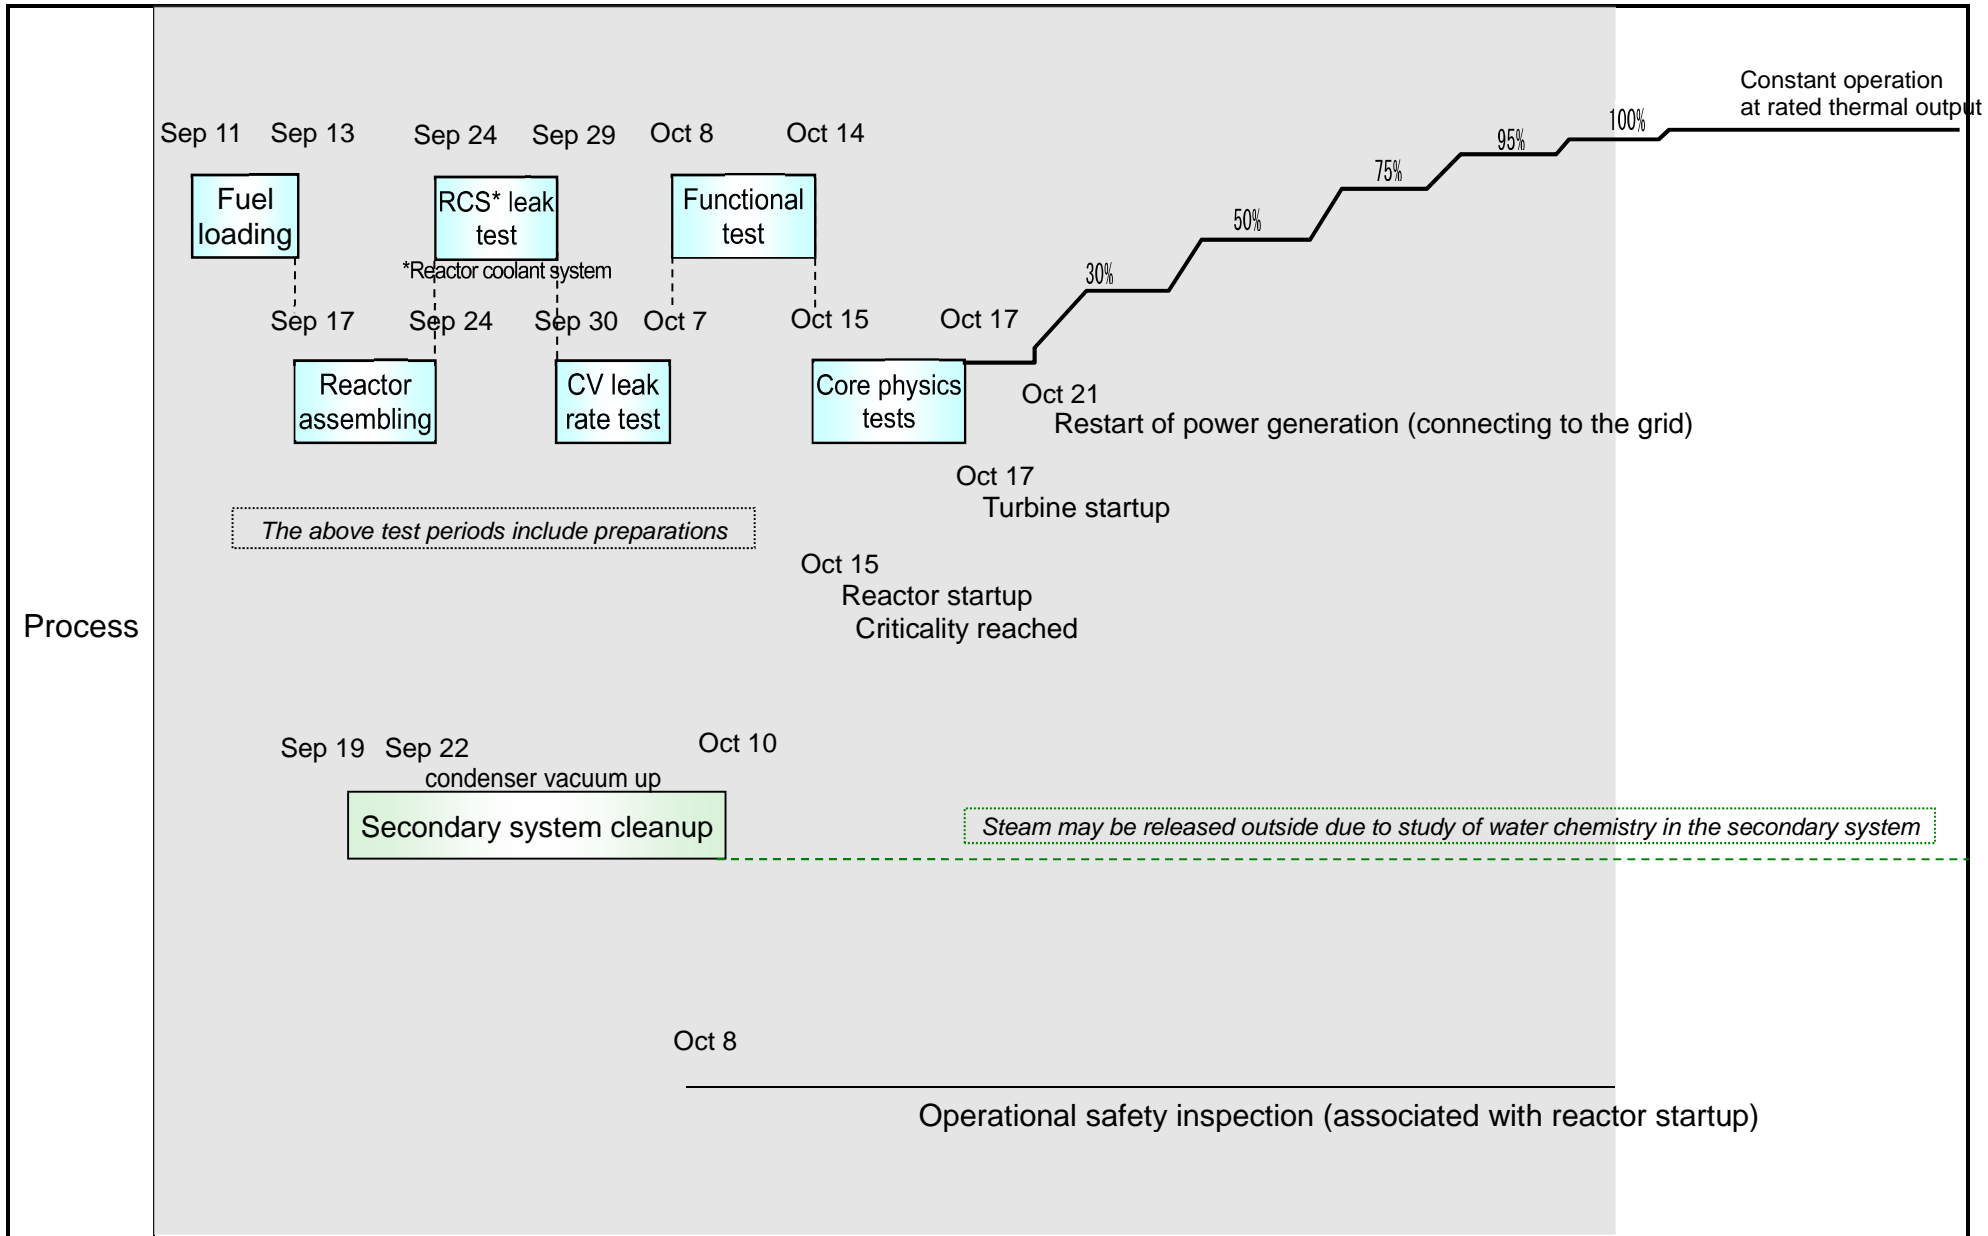

Translated by JANSI: For the original text, please go to: [http://www.kyuden.co.jp/var/rev0/0049/1340/news\\_2\\_151031.pdf](http://www.kyuden.co.jp/var/rev0/0049/1340/news_2_151031.pdf)