


## Sendai Nuclear Power Station Unit 2: Plant status as of 11:30am, November 1 (Daily report: FINAL)

	Operations
Results (10:00, Oct 31 – 11:30, Nov 1)	<p>[Electric power] <b>Constant operation with the rated thermal power</b>, as of 11:30 Nov 1</p> <p>[Main process]</p> <ul style="list-style-type: none"><li>➤ The primary system (reactor system)<ul style="list-style-type: none"><li>• None</li></ul></li><li>➤ The secondary system (turbine and generator system)<ul style="list-style-type: none"><li>• Nov 1 Load up beyond 100% electric output conducted</li><li>• Nov 1 Constant operation with the rated thermal power achieved</li></ul></li></ul> <p>[Tests and inspections]</p> <ul style="list-style-type: none"><li>➤ Operator's self-inspection (periodical equipment inspection items)<ul style="list-style-type: none"><li>• None</li></ul></li><li>➤ Regulatory inspection<ul style="list-style-type: none"><li>• Inspection associated with the reactor startup ongoing (started on Oct 8)</li></ul></li></ul>

Translated by JANSI: For the original text, please go to: [http://www.kyuden.co.jp/var/rev0/0049/1339/news\\_2\\_151101.pdf](http://www.kyuden.co.jp/var/rev0/0049/1339/news_2_151101.pdf)

# Sendai Unit 2: Restart operation process

Nov 1, 2015

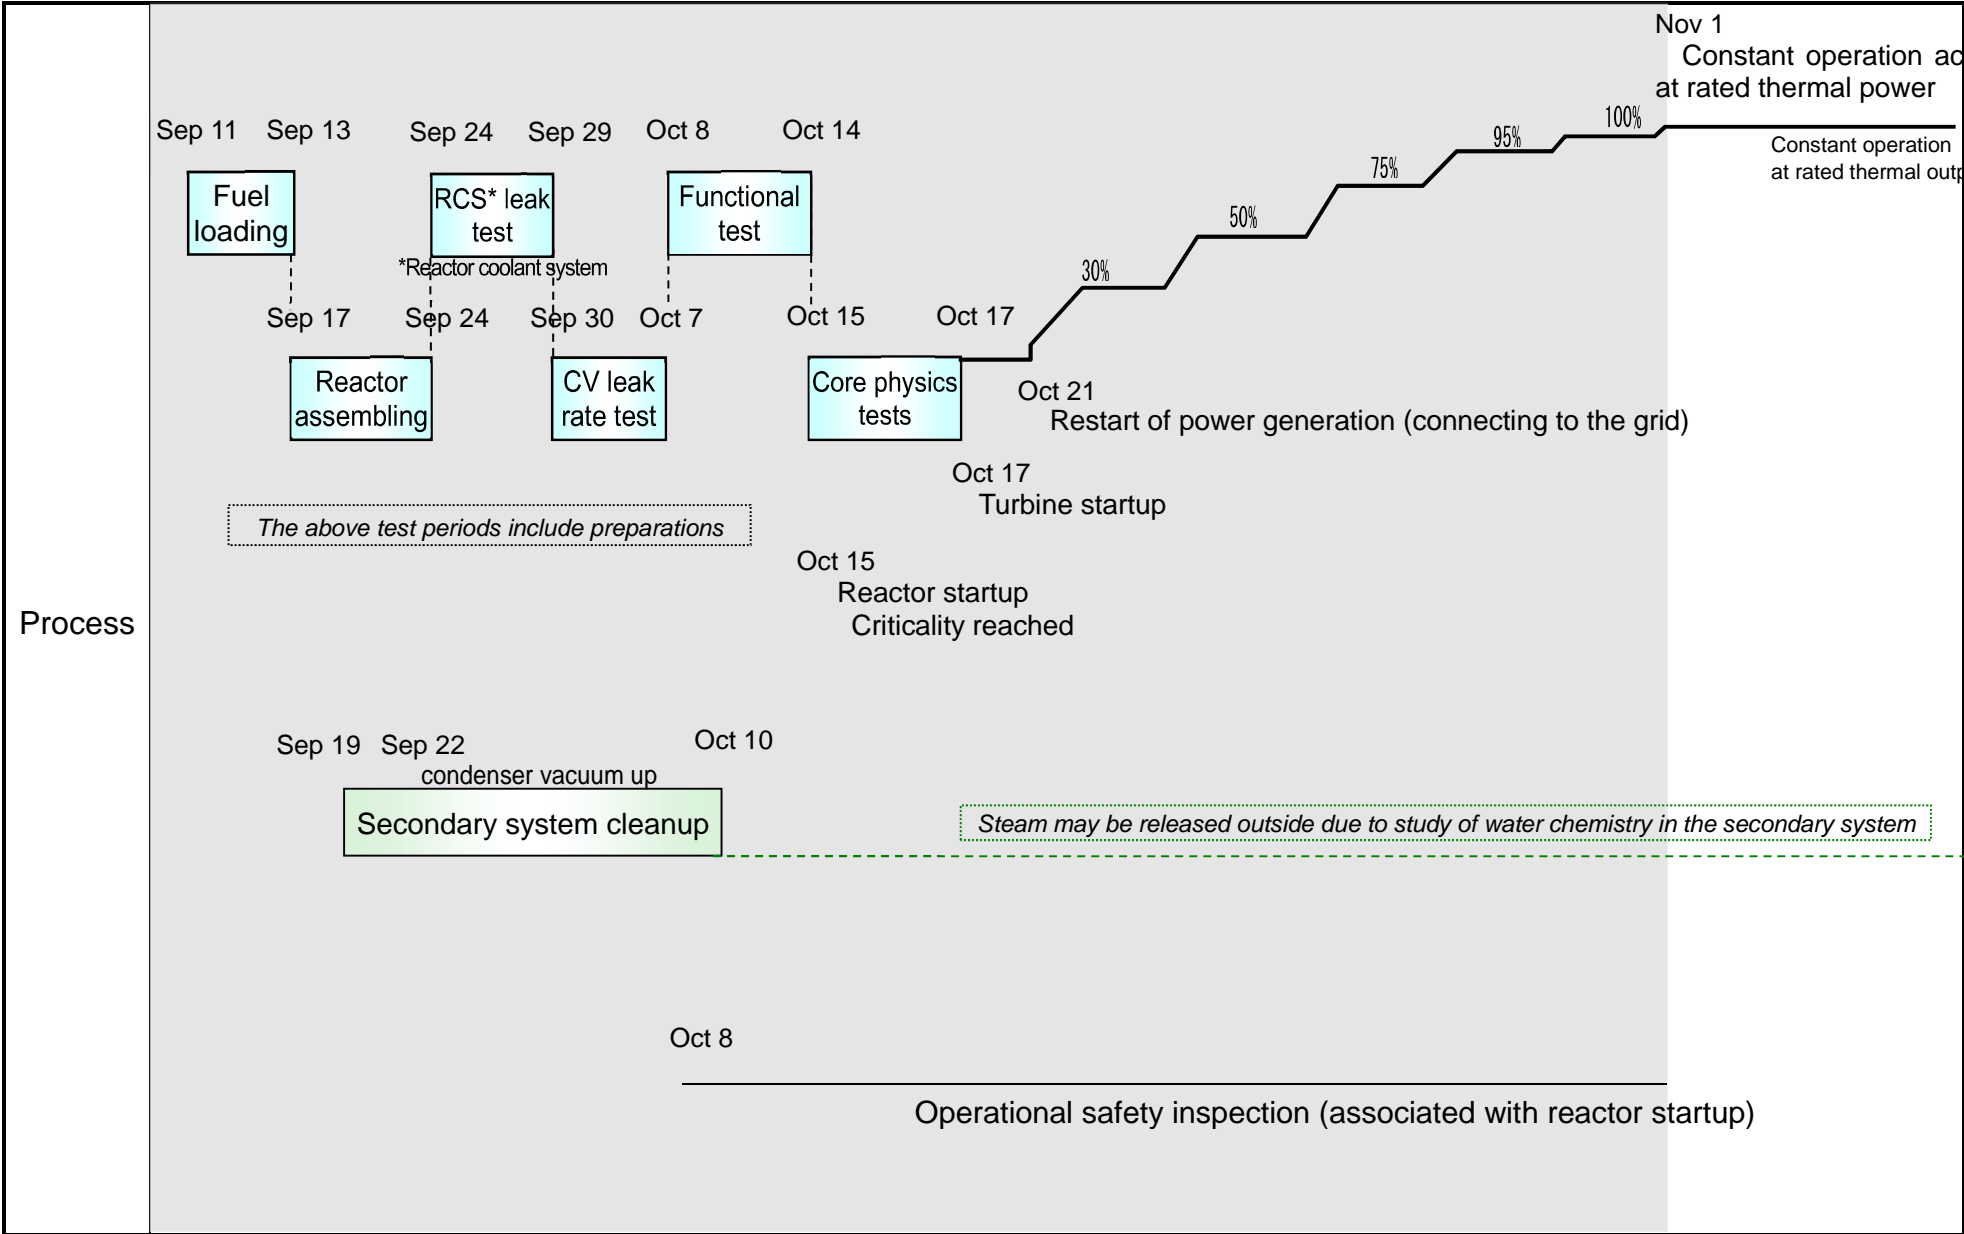

Translated by JANSI: For the original text, please go to: [http://www.kyuden.co.jp/var/rev0/0049/1339/news\\_2\\_151101.pdf](http://www.kyuden.co.jp/var/rev0/0049/1339/news_2_151101.pdf)